



# JUMO dTRANS T05

## Programmable two-wire transmitter

for installation into terminal head form B and for installation on DIN rail

### Brief description

The transmitters record sensor signals from RTD temperature probes, thermocouples, resistance transmitters, or resistors/potentiometers. When using a resistor/potentiometer or RTD temperature probe, the sensor connection on the input side can be connected with a two-wire, three-wire, or four-wire circuit. Voltage signals in the range from -100 to +1100 mV can also be recorded. Depending on the selected measurement input, the linear and temperature-linear linearization variants and the possibility of easily configurable customer-specific linearization are available.

Type 707050 delivers 4 to 20 mA as an output signal. Type 707051 delivers 4 to 20 mA or 0 to 10 V as an output signal. The measurement input and the output signal are galvanically isolated from one another. The output signal can be reversed for both types.

The transmitter configuration with respect to probe type, connection technology of the probe, measuring range (user configurable), and linearization is carried out by a setup program on the PC. The connection to the PC is established via a USB interface which does not require additional auxiliary voltage. Via the USB interface, the min./max. process value and the min./max. operating temperature recorded by the transmitter can be read and the sensor wiring can be checked online.

The operating status of the transmitter is indicated by a two-color control LED (red/green). The control LED is lit green during malfunction-free operation. A fault such as a probe break will be shown by the corresponding LED signaling.




Type 707050 (dTRANS T05 B)



Type 707051 (dTRANS T05 T)

### Block diagram

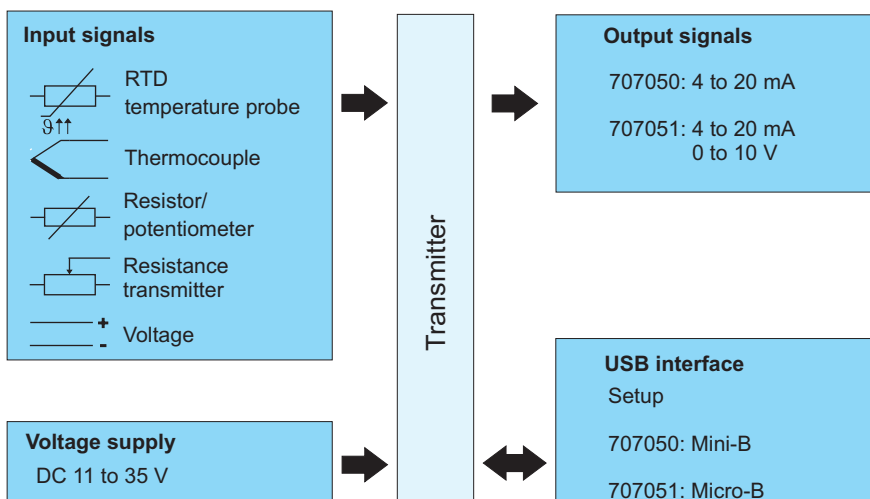

### Special features

- Measuring input for RTD temperature probe, thermocouple, resistor/potentiometer, resistance transmitter, and voltage
- Input and output are electrically isolated
- Control LED (red/green)
- Configuration directly via USB cable without additional auxiliary voltage
- Customer-specific linearization
- Detection of the min./max. process value (drag pointer function including point in time)
- Option to specify the temperature in °F for temperature sensors
- Type 707051 available with screw terminals or spring-cage terminals

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Technical data

### Analog input

All analog inputs are equipped with a digital filter of second order (filter constant adjustable from 0 to 10 s) and have a sampling rate of > 2 measurements per second.

### RTD temperature probes

Description	Standard	ITS	Connection type	Measuring range in °C		Measuring accuracy <sup>a</sup>			
				Min.	Max.				
Pt100 Pt500 Pt1000 $T_K = 3.85 \times 10^{-3} \text{ 1/K}$	IEC 60751:2008	ITS-90	Two/three-wire	-100	200	±0.2 K			
			Two/three-wire	-200	850	±0.4 K			
			Four-wire	-100	200	±0.1 K			
			Four-wire	-200	850	±0.2 K			
Pt100 $T_K = 3.917 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.2	ITS-90	Two/three-wire	-100	200	±0.2 K			
			Two/three-wire	-200	850	±0.4 K			
			Four-wire	-100	200	±0.15 K			
			Four-wire	-200	850	±0.25 K			
			Two/three-wire	-200	850	±0.5 K			
			Four-wire	-200	850	±0.3 K			
Pt50 $T_K = 3.91 \times 10^{-3} \text{ 1/K}$	DIN 43760	IPTS-68	Two/three-wire	-60	250	±0.4 K			
			Four-wire	-60	250	±0.2 K			
			Two/three-wire	-60	250	±0.4 K			
			Four-wire	-60	250	±0.2 K			
			Two/three-wire	-60	250	±0.4 K			
			Four-wire	-60	250	±0.2 K			
			Ni100 $T_K = 6.18 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.5	ITS-90	Two/three-wire	-60	180	±0.4 K
						Four-wire	-60	180	±0.2 K
Ni500 $T_K = 6.18 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.3	ITS-90	Two/three-wire	-180	200	±0.5 K			
			Four-wire	-180	200	±0.3 K			
			Two/three-wire	-180	200	±0.4 K			
			Four-wire	-180	200	±0.2 K			
Ni1000 $T_K = 6.18 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.3	ITS-90	Two/three-wire	-180	200	±0.4 K			
			Four-wire	-180	200	±0.2 K			
Ni100 $T_K = 6.17 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.3	ITS-90	Two/three-wire	-180	200	±0.5 K			
			Four-wire	-180	200	±0.3 K			
Cu50 $T_K = 4.28 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.3	ITS-90	Two/three-wire	-180	200	±0.5 K			
			Four-wire	-180	200	±0.3 K			
Cu100 $T_K = 4.28 \times 10^{-3} \text{ 1/K}$	GOST 6651-2009 A.3	ITS-90	Two/three-wire	-180	200	±0.4 K			
			Four-wire	-180	200	±0.2 K			

<sup>a</sup> The accuracy values refer to the complete measuring range.

Connection type	Two-wire, three-wire, or four-wire circuit
Sensor line resistance for three and four-wire circuit for two-wire circuit	≤ 11 Ω per wire Measuring resistance + ≤ 22 Ω internal conductor resistance
Sensor current	< 0.3 mA

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Thermocouples

Designation	Type	Standard	ITS	Measuring range in °C		Measuring accuracy <sup>a</sup>
				Min.	Max.	
Pt13Rh-Pt	R	IEC 584-1	ITS-90	-50	1768	± 0.15 % from +50 °C
Pt10Rh-Pt	S	IEC 584-1	ITS-90	-50	1768	± 0.15 % from +20 °C
Pt30Rh-Pt6Rh	B	IEC 584-1	ITS-90	0	1820	± 0.15 % from +400 °C
Fe-CuNi	J	IEC 584-1	ITS-90	-210	1200	± 0.1 % from -100 °C
Cu-CuNi	T	IEC 584-1	ITS-90	-270	400	± 0.1 % from -150 °C
NiCr-CuNi	E	IEC 584-1	ITS-90	-270	1000	± 0.1 % from -80 °C
NiCr-Ni	K	IEC 584-1	ITS-90	-270	1372	± 0.1 % from -80 °C
NiCrSi-NiSi	N	IEC 584-1	ITS-90	-270	1300	± 0.1 % from -80 °C
Fe-CuNi	L	DIN 43710	IPTS-68	-200	900	± 0.1 %
Cu-CuNi	U	DIN 43710	IPTS-68	-200	600	± 0.1 % from -100 °C
Chromel-Copel (Ni9.5Cr-Cu44Ni)	L	GOST R 8.585-2001	ITS-90	-200	800	± 0.1 % from -80 °C
Chromel-Alumel		GOST R 8.585-2001	ITS-90	-270	1372	± 0.1 % from -80 °C
W5Re-W20Re	A1	GOST R 8.585-2001	ITS-90	0	2500	± 0.15 %
W5Re-W26Re	C	ASTM E230/E230M-11	ITS-90	0	2315	± 0.15 %
W3Re-W25Re	D	ASTM E1751/E1751M-09	ITS-90	0	2315	± 0.25 %
PL II (Platinel <sup>®</sup> II)		ASTM E1751/E1751M-09	ITS-90	0	1395	± 0.15 %

Cold junction	Pt1000 internal or external cold junction; temperature adjustable 0 to 80 °C
Cold junction accuracy	± 1 K

<sup>a</sup> The accuracy values refer to the complete measuring range.

<sup>b</sup> Platinel is a registered trademark of Engelhardt Corp.

## Resistance transmitter and resistor/potentiometer

Designation	Measuring range	Measuring accuracy
Resistance transmitter	Up to 10000 Ω	±10 Ω
Resistor/potentiometer	≤ 400 Ω ≥ 400 Ω to ≤ 4000 Ω > 4000Ω to ≤ 10000Ω	± 400 mΩ ± 4 Ω ± 10 Ω
Connection type	Resistance transmitter: three-wire circuit (A = Start, S = Slider, E = End) Resistor/potentiometer: two-wire circuit, three-wire circuit, and four-wire circuit	
Sensor lead resistance	≤ 11 Ω per line for two-wire circuit, three-wire circuit, and four-wire circuit	

## Direct voltage

Designation	Measuring range	Accuracy <sup>a</sup>	Input resistance
Input for mV generator	-100 to 1100 mV	±0.05 %	R <sub>E</sub> ≥ 1 MΩ

<sup>a</sup> The accuracy value refers to the complete measuring range.

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Measuring circuit monitoring

	Type 707050	Type 707051
Underrange	Linear drop up to 3.8 mA (According to NAMUR recommendation 43)	Linear drop up to 3.8 mA (According to NAMUR recommendation 43) Linear drop up to -0.12 V
Overrange	Linear drop up to 20.5 mA (According to NAMUR recommendation 43)	Linear drop up to 20.5 mA (According to NAMUR recommendation 43) Linear increase up to 10.31 V
Probe short circuit/probe and open circuit	RTD temperature probe: (configurable) ≤ 3.6 mA or ≥ 21.7 mA  Or free setting: 3.6 up to 23 mA	RTD temperature probe: (configurable) ≤ 3.6 mA or ≥ 21.7 mA  Or free setting: 3.6 up to 23 mA ≤ -0.2 V or ≥ 11.0 V Or free setting: -0.25 up to +11.875 V
		Thermocouple: (configurable) <sup>a</sup> ≤ 3.6 mA or ≥ 21.7 mA Or free setting: 3.6 up to 23 mA
	Thermocouple: (configurable) <sup>a</sup> ≤ 3.6 mA or ≥ 21.7 mA Or free setting: 3.6 up to 23 mA	Thermocouple: (configurable) <sup>a</sup> ≤ 3.6 mA or ≥ 21.7 mA Or free setting: 3.6 up to 23 mA ≤ -0.2 V or ≥ 11.0 V Or free setting: -0.25 up to +11.875 V
		Thermocouple: (configurable) <sup>a</sup> ≤ 3.6 mA or ≥ 21.7 mA Or free setting: 3.6 up to 23 mA
Current limiting in the event of a probe short circuit or probe break	≤ 23 mA	

<sup>a</sup> For thermocouples and mV generators a probe short-circuit detection is not possible.

## Output

	Type 707050	Type 707051
Output signal	Load-independent direct current: Free setting: 4 to 20 mA or 20 to 4 mA	Load-independent direct current: Free setting: 4 to 20 mA or 20 to 4 mA
		Voltage signal: Free setting: 0 to 10 V or 10 to 0 V
Electrical isolation	Between input and output: $\hat{U} = 3.75 \text{ kV}/50 \text{ Hz}$	Between input and output: $\hat{U} = 1.875 \text{ kV}/50 \text{ Hz}$
Test voltage		
Transmission behavior	Linear, temperature-linear Customer specific Reversion of the output signal	
Step response 0 to 100 %	< 2 s (with filter constant 0 s)	
Switch-on delay	5 s (correct measured value after the supply voltage is applied)	
	<b>Current output</b>	
Load ( $R_b$ )	$R_b = (U_b - 11 \text{ V}) \div 0.022 \text{ A}$	
Load error	≤ ±0.02 %/100 Ω	
Calibration conditions/accuracy	DC 24 V at approx. 22 °C/±0.05 % <sup>a</sup>	
	<b>Voltage output</b>	
Load resistance	≥ 2 kΩ	
Load influence	± 15 mV	
Residual ripple	± 1 % referring to 10 V, 0 to 90 kHz	
Calibration conditions/accuracy	DC 24 V at approx. 22 °C/±0.05 % <sup>b</sup>	

<sup>a</sup> All specifications refer to the measuring range end value of 20 mA

<sup>b</sup> All specifications refer to the measuring range end value of 10 V

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Interfaces

	Type 707050	Type 707051
USB device	To operate the setup program	
Type	USB interface 2.0; Full-speed	
Connection port	Mini-B	Micro-B

## Customer-specific linearization

Method	Characteristics
Pairs of values	Max. number: 40 Interpolation: linear
Formula	Number of coefficients: 5 Polynomial: 4th order

## Voltage supply

	Type 707050	Type 707051
Voltage supply ( $U_b$ )	DC 11 to 35 V (with reverse voltage protection <sup>a</sup> ) Only for operation in SELV, PELV current circuits according to DIN EN 50178	
Voltage supply error	$\leq \pm 0.01\%$ deviation from 24 V <sup>b</sup>	
Requirement	The device must be equipped with an electrical circuit that meets the requirements of EN 61010-1 with regard to "Limited-energy circuits".	

<sup>a</sup> Prerequisite for use of the voltage output of type 707051 is a voltage supply of at least 15 V

<sup>b</sup> All specifications refer to the measuring range end value of 20 mA

## Environmental influences

	Type 707050	Type 707051
Operating temperature range	-40 to +85 °C	-10 up to +70 °C
Storage temperature range	-40 to +100 °C	-10 up to +70 °C
Temperature influence	RTD temperature probes $\leq \pm 0.005\%$ deviation from 22 °C <sup>a</sup> Resistance transmitter $\leq \pm 0.01\%$ deviation from 22 °C <sup>a</sup> Resistance/potentiometer $\leq \pm 0.01\%$ deviation from 22 °C <sup>a</sup> Thermocouple $\leq \pm 0.005\%$ deviation from 22 °C <sup>a</sup> (plus accuracy of the cold junction) Direct current $\leq \pm 0.01\%$ deviation from 22 °C <sup>a</sup>	
Long-term stability	$\leq 0.1$ K/year <sup>b</sup> or $\leq 0.05\%$ year <sup>c</sup>	
Resistance to climatic conditions	In terminal head, form B Rel. humidity $\leq 95\%$ , with condensation Open assembly Rel. humidity $\leq 95\%$ , without condensation On DIN-rail Climate class 3K8H acc. to DIN EN 60721-3-3	Rel. humidity $\leq 95\%$ , without condensation 3K8H acc. to DIN EN 60721-3-3
Vibration resistance	DIN EN 60068-2-6 Max. 2 g at 10 to 2000 Hz DIN EN 60068-2-27 Shock; 10 g/6 ms Germanischer Lloyd Characteristic line 2	Max. 2 g at 10 to 55 Hz Shock; 10 g/6 ms -
Electromagnetic compatibility (EMC)	According to DIN EN 61326-1 Interference emission Class B Interference immunity Industrial requirement	

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



	Type 707050	Type 707051
IP protection type		
In terminal head, form B	IP54/IP65 (depending on the version)	
Open assembly	IP00	
On DIN-rail		IP20

- <sup>a</sup> All specifications refer to the measuring range end value of 20 mA or 10 V.
- <sup>b</sup> Under calibration conditions.
- <sup>c</sup> % refers to the set measuring span. The greater value of the long-term stability applies.

## Case

	Type 707050	Type 707051
Material	Polycarbonate UL 94 V2 (grouted)	Polybutylene terephthalate UL 94 V0
Terminal type	Screw terminals:	Screw terminals:
Wire type	Rigid and flexible wires ≤ 1.75 mm <sup>2</sup> ;  Max. torque 0.6 Nm	Rigid and flexible wires 0.2 to 2.5 mm <sup>2</sup> AWG/kcmil min. 26, max. 12 Stripping length 12 mm Torque 0.5 to 0.6 Nm
		Spring-cage terminals Rigid and flexible wires 0.2 to 2.5 mm <sup>2</sup> AWG/kcmil min. 26, max. 12 Stripping length 8 mm
Assembly type	In terminal head, form B (DIN EN 50446); In the surface-mounted case (see accessories); In the control cabinet (mounting element required)	On DIN rail TH 35-7.5 Or TH 35-15 (DIN EN 60715);
Installation position	Any	
Weight	~ 35 g	~ 50 g

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net


**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Setup program

The transmitter is configured on the PC with the setup program. The connection between transmitter and PC is established via a USB cable. The transmitter interface is a USB port of the Mini-B type (707050) or of the Micro-B type (707051). It supports standard 2.0 "Full-speed". Once configuration of the transmitter has been completed make sure that the attached hinged-on lid is back on the transmitter's USB interface.

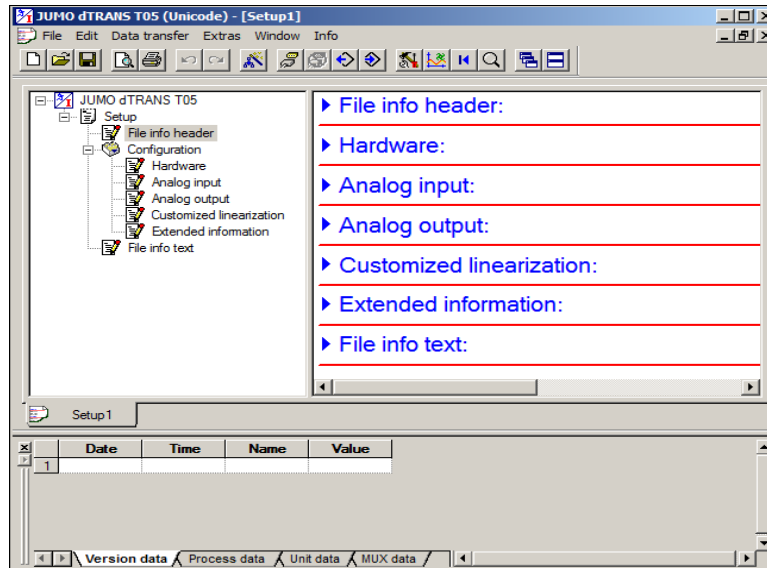

## Configurable parameters

Sensor type	
Connection type two, three, or four-wire circuit for RTD temperature probe or resistance/potentiometer	
Linearization	
Customer-specific linearization	
Noise suppression	
Sensor factor for thermocouple / RTD temperature probe	
Lead wire resistance for two-wire circuit	
External or internal cold junction for thermocouple	
Scaling	
Digital filter	
Offset	
Unit	
Behavior in the event of a probe break/short-circuit	
Output signal increasing or decreasing (reversion)	
Output functions, current Type 705050 and type 705051	4 to 20 mA 4 to 20 mA scalable (start/end) Constant current source
Output functions, voltage Only type 705051	0 to 10 V 0 to 10 V scalable (start/end) Constant voltage source
TAG number (10-digit) and description (20-digit)	
Installation date	
Version, process, and device data of the transmitter can be displayed	

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com




### Hardware and software requirements

A PC with USB interface is required to operate the setup program. Details about supported operating systems (Microsoft® Windows®), required hard disk drive space, and memory can be found under information about the setup program on the manufacturer's website (search for 707050, in the search results click the link to the product, go to software, and look for further information about the setup program).


## Connection diagram

The connection diagram in the data sheet provides preliminary information about the connection possibilities. Only use the operating manual for the electrical connection. The knowledge and the correct technical execution of the safety information/instructions contained in these documents are a prerequisite for installation, electrical connection, and startup as well as for safety during operation.

### Connection example dTRANS T05 B

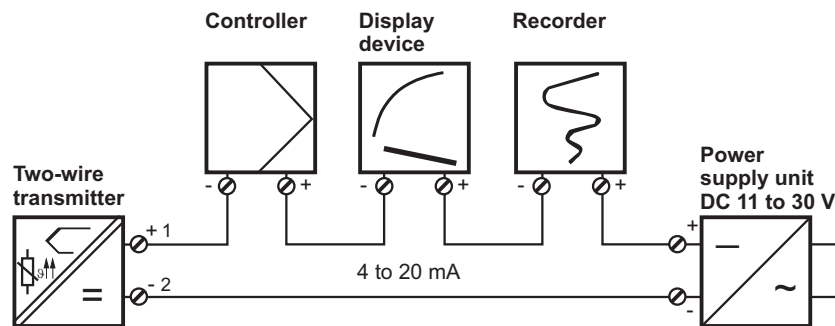

### Terminal assignment and dimensions (mm) dTRANS T05 B

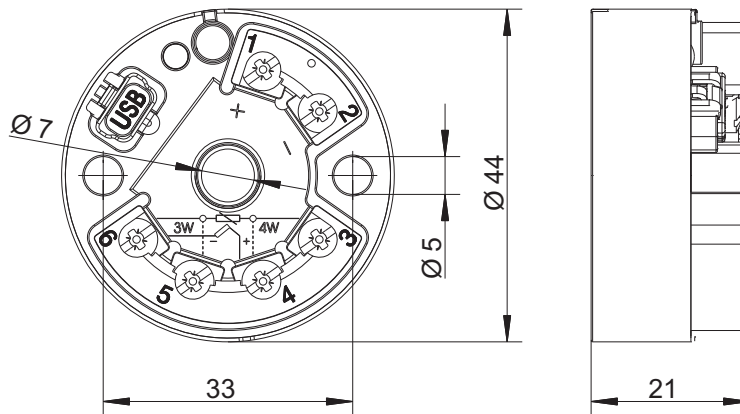



**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



Type 707050		
Connection for	Terminal assignment	
Voltage supply Type 707050 DC 11 to 35 V	$R_B = (U_b - 11 \text{ V}) \div 22 \text{ mA}$	
Current output 4 to 20 mA	$R_B = \text{Load resistance}$ $U_b = \text{Voltage supply}$	
<b>Analog inputs</b>		
RTD temperature probe two-wire circuit	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
RTD temperature probe three-wire circuit (3W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
RTD temperature probe four-wire circuit (4W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Thermocouple		
Resistor/potentiometer two-wire circuit	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistor/potentiometer three-wire circuit (3W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistor/potentiometer four-wire circuit (4W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistance transmitter	E = End S = Slider A = Start	
Voltage 0 to 1 V		
<b>Interface</b>		
USB device	Mini-B, standard (5-pin)	


**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk


**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



### Connection example dTRANS T05 T

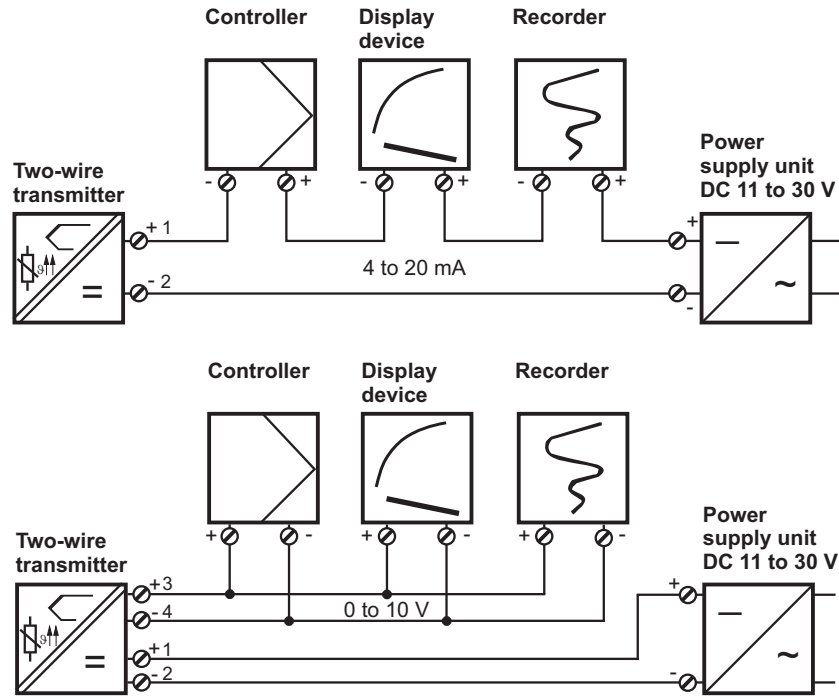

### Connection assignment and dimensions (mm) dTRANS T05 T

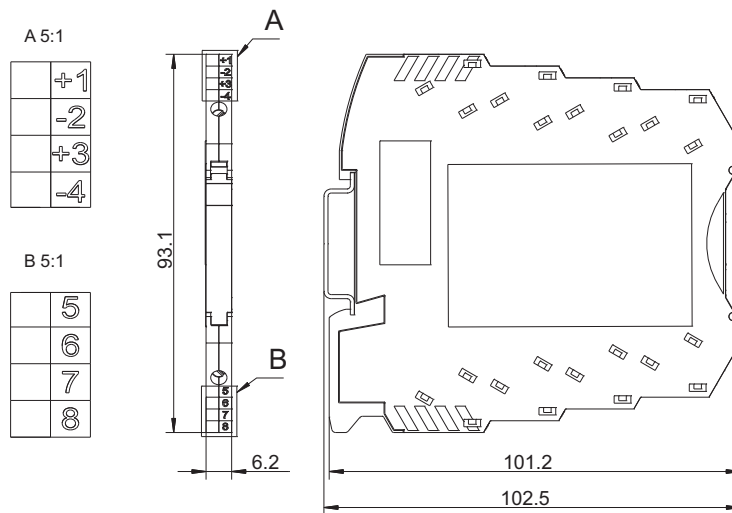

This figure shows type 707051 installed on a DIN rail TH 35-7.5. The specifications concerning dimensions only valid for the installation on this DIN rail and change accordingly if a DIN rail TH 35-15 is used.

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



Type 707051		
Connection for	Terminal assignment	
Voltage supply Type 707051 DC 11 to 35 V	$R_B = (U_b - 11 \text{ V}) \div 22 \text{ mA}$	
Current output 4 to 20 mA	$R_B = \text{Load resistance}$ $U_b = \text{Voltage supply}$	
Voltage output 0 to 10 V		
<b>Analog inputs</b>		
RTD temperature probe two-wire circuit	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
RTD temperature probe three-wire circuit (3W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
RTD temperature probe four-wire circuit (4W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Thermocouple		
Resistor/potentiometer two-wire circuit	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistor/potentiometer three-wire circuit (3W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistor/potentiometer four-wire circuit (4W)	$R_L \leq 11 \Omega$ $R_L = \text{Lead resistance per wire}$	
Resistance transmitter	E = End S = Slider A = Start	
Voltage 0 to 1 V		
<b>Interface</b>		
USB device	Micro-B, standard (5-pin)	

**JUMO GmbH & Co. KG**  
 Delivery address: Mackenrodtstraße 14  
 36039 Fulda, Germany  
 Postal address: 36035 Fulda, Germany  
 Phone: +49 661 6003-0  
 Fax: +49 661 6003-607  
 Email: mail@jumo.net  
 Internet: www.jumo.net

**JUMO Instrument Co. Ltd.**  
 JUMO House  
 Temple Bank, Riverway  
 Harlow, Essex CM 20 2DY, UK  
 Phone: +44 1279 63 55 33  
 Fax: +44 1279 62 50 29  
 Email: sales@jumo.co.uk  
 Internet: www.jumo.co.uk

**JUMO Process Control, Inc.**  
 6733 Myers Road  
 East Syracuse, NY 13057, USA  
 Phone: +1 315 437 5866  
 Fax: +1 315 437 5860  
 Email: info.us@jumo.net  
 Internet: www.jumousa.com



## Order details

### (1) Basic type

	707050	dTRANS T05 B – Two-wire transmitter for installation in terminal head, form B
	707051	dTRANS T05 T – Two-wire transmitter for mounting on DIN-rail

### (2) Configuration

x	x	8	Factory-set (0 to 100 °C, Pt100 three-wire circuit, 4 to 20 mA)
x	x	9	Customer-specific setting

### (3) Electrical connection type

x	x	06	Screw terminals
	x	07	Spring-cage terminals

Order code  /  -

Order example 707050 / 8 - 06

## Scope of delivery

1 transmitter in the version ordered
For type 707050: including fastening material (2 screws, 2 pressure springs, and 2 retaining washers)
1 operating manual

## Accessories

Description	Part no.
Setup program on CD-ROM, multilingual	00574959
USB cable, A-connector to Mini-B connector, length 3 m, for type 707050	00506252
USB cable, A-connector to Micro-B connector, length 3 m, for type 707051	00616250
USB cable set (mini/micro USB), length 3 m	00639360
Mounting element for mounting of type 707050 on mounting rail	00352463
Screw-on end clamp for mounting rail	00528648